


TYPICAL NOTES:

- 1)-ALL EXPOSED PIPING AND FITTINGS TO BE GALVANIZED WITH EXCEPTION OF STORZ CONNECTION
- 2)-40' MAX. FROM FDC TO FIRE APPARATUS ACCESS (DRIVEWAY)
- 3)-FOR NFPA 13R SYSTEMS (2 1/2" RISER AND SMALLER) SINGLE FDC W/ HOPE MILLS THREADS (3.340 X 6 SHARPE V FORM)
- 4)-WHEN BUILDING HT. IS GREATER THAN 200' USE RAL. SIAMESE
- 5)-AN APPROVED CONNECTION (TAPPING NOT APPROVED)

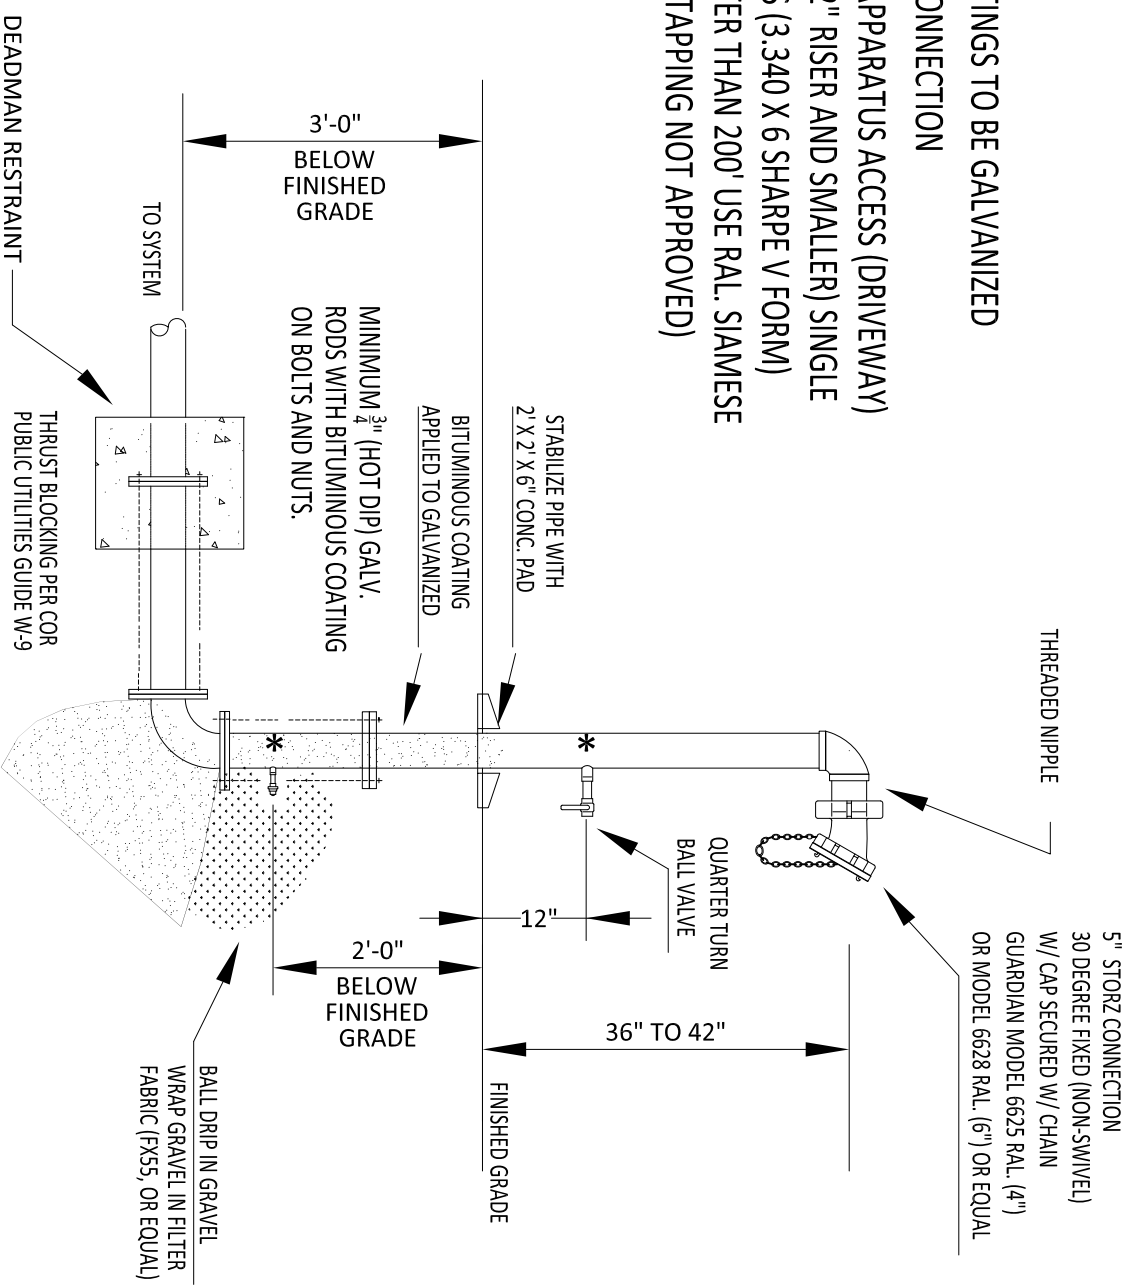

DETAIL NOT TO SCALE

YARD FDC DETAIL REQUIREMENTS

FIRE PROTECTION

Detail FP-15

Town of Hope Mills, North Carolina

February 28, 2015 Original

