


- TYPICAL NOTES:
- 1)-ALL PIPING AND FITTINGS TO BE DUCTILE IRON, GALVANIZED BRASS, STAINLESS STEEL, OR ALUMINUM.
  - 2)-40' MAX. FROM FDC TO APPARATUS ACCESS LOCATION.
  - 3)-FDC TO FACE FIRE APPARATUS ACCESS LOCATION (DRIVEWAY).
  - 4)-DO NOT BLOCK APPARATUS ACCESS TO BUILDING WITH HOSE. LAY FROM HYDRANT TO FDC.
  - 5)-MINIMUM DISTANCE 3 FEET BEHIND CURB, PROTECT FROM VEHICLES.
  - 6)-PROVIDE HEAT AND ALARM SUPERVISION TO HOT BOX (2 CONDUITS).
  - 7)-COMPLY WITH PUBLIC UTILITIES HANDBOOK REQUIREMENTS
  - 8)-MAINTAIN ACCESS TO VALVE PIT

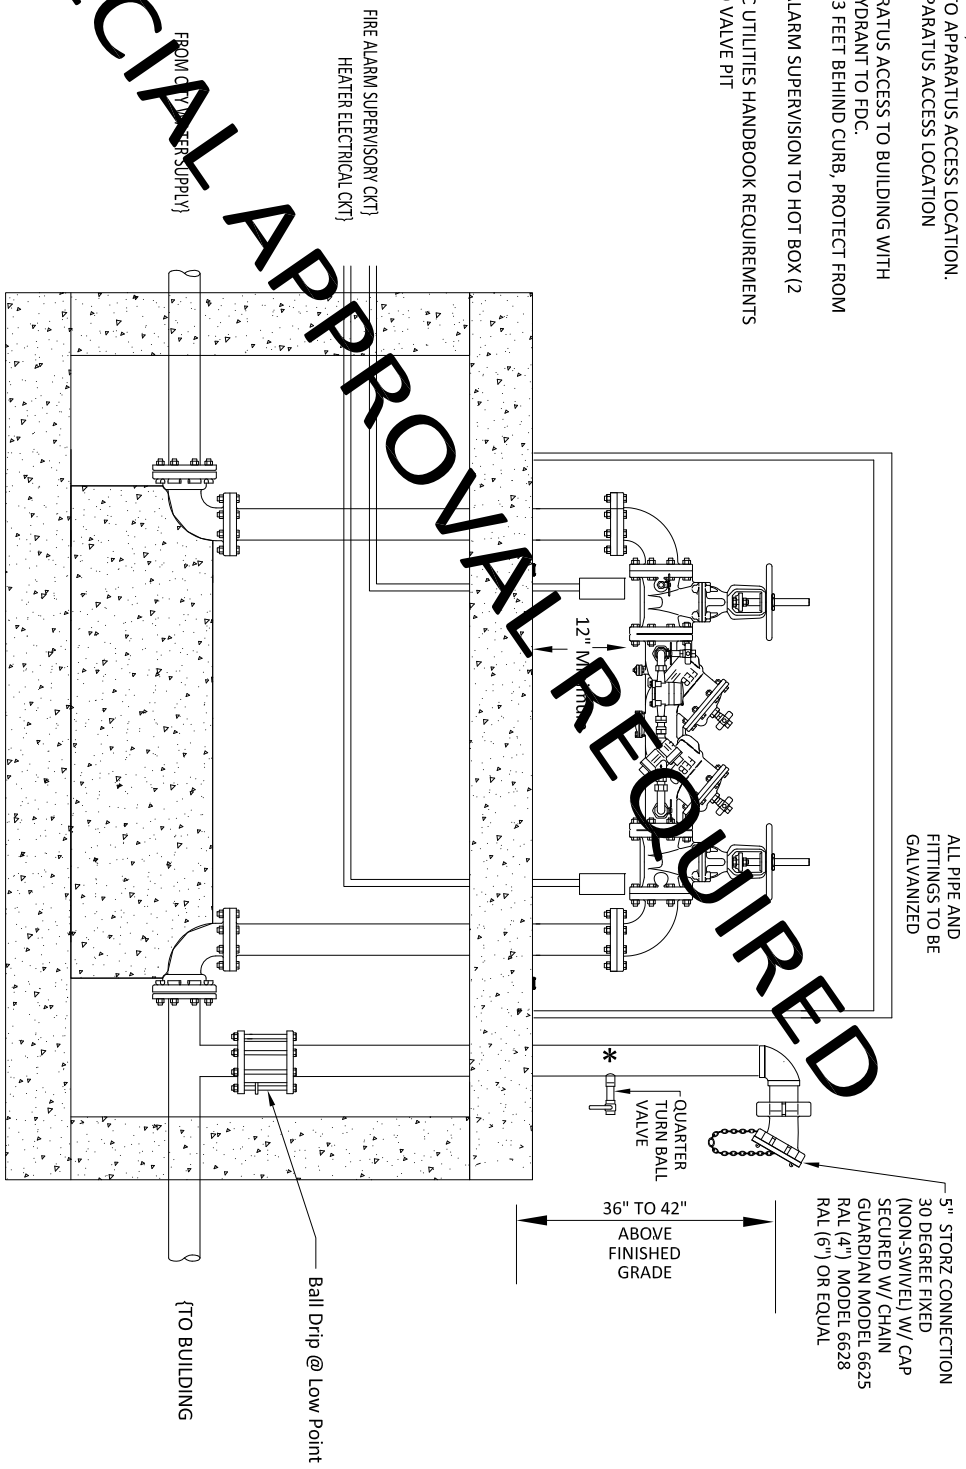

DETAIL NOT TO SCALE

SPECIAL APPROVAL REQUIRED

## RETROFIT BACKFLOW PREVENTER

### FIRE PROTECTION

Detail FP-19

Town of Hope Mills, North Carolina

February 28, 2015 Original

