



# NFPA 72 AND ADA DEVICE INSTALLATION REQUIREMENTS

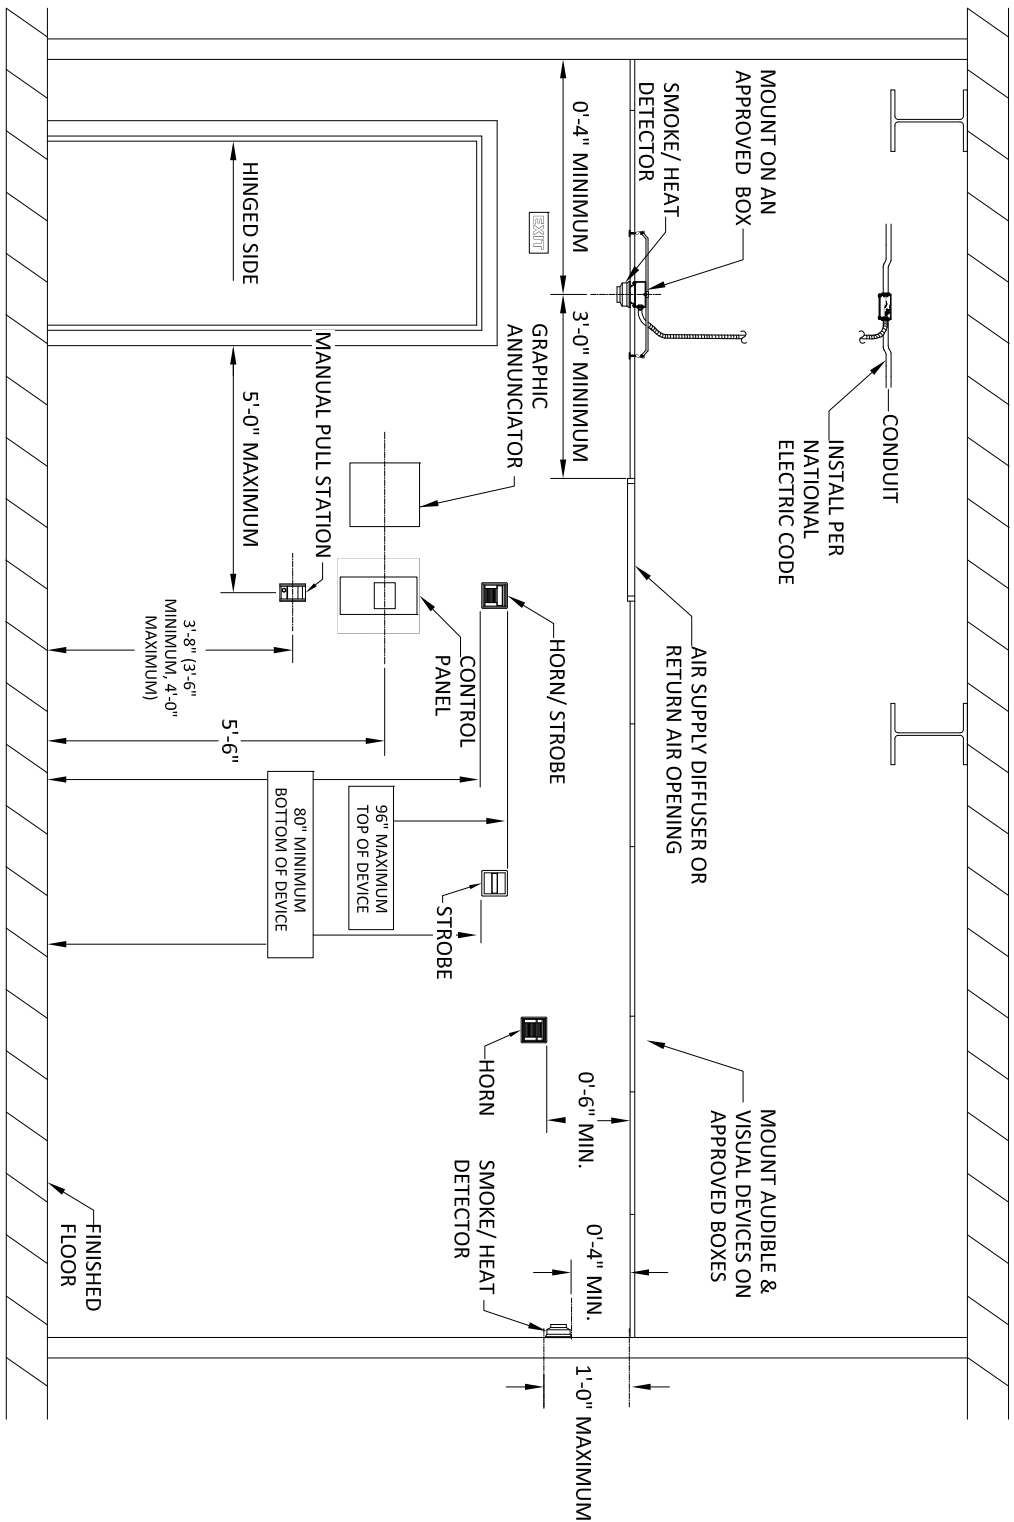

DETAIL NOT TO SCALE



## FIRE ALARM DEVICE MOUNTING

### FIRE PROTECTION

Detail FP-26

Town of Hope Mills, North Carolina

February 28, 2015 Original